


PLAN VIEW

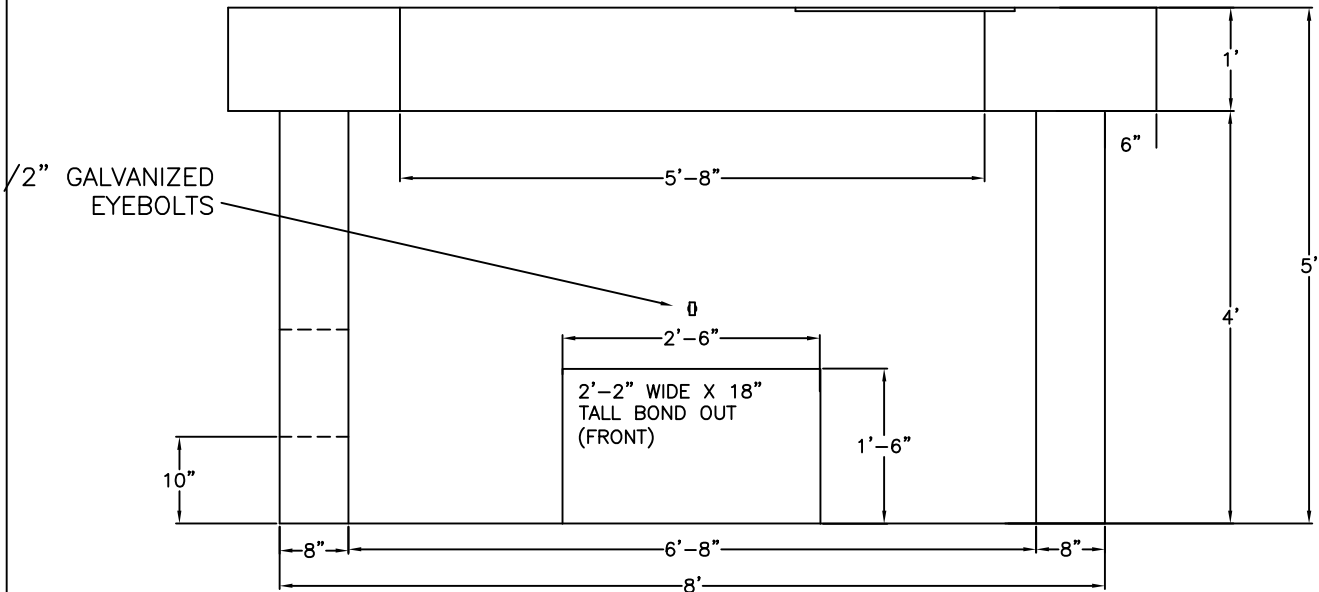

SECTION A-A

DESIGN DATA & GENERAL NOTES

- 1) CONCRETE: 5,000 PSI @ 28 DAYS.
- 2) CEMENT: PORTLAND TYPE III PER ASTM C150
- 3) REINFORCING: PER ASTM A615. GRADE 60
- 4) MEETS ALL CENTRAL MAINE POWER COMPANY SPECIFICATIONS FOR 75-500 KVA CONDITIONS.
- 5) APPROX. WEIGHT 24,000 LBS.

TRANSFORMER PAD- 108"X108" (3 PHASE)
(LARGE, 75-2500 KVA, 30)

George R. Roberts Co.
Precast Concrete Products

TPB-108, TPT-108

www.georgerobertsco.com

192 Biddeford Road Phone 207-324-6571
Alfred, Maine 04002 Fax 207-324-8533